



Duct Controller and Sensor SDC2-T

The SDC2-T is a programmable controller and sensor with communication capabilities. Each control loop may use 2 PI sequences and 2 binary stages. The SDC2-T comes with a built in RS485 communication interface that allows peer-to-peer communication with an operation terminal such as OPT1-(2TH)-VC. Complete parameter sets may be copied by use of an accessory called AEC-PM2 or exchanged with a PC using an RS485-USB converter and the EasySet program. The SDC2-T uses the universal X2 operating system. Communication options are realized with Modbus RTU/ASCII and BACnet® MS/TP.

Applications

- Ventilation control
- Air measurement
- Zone control
- VAV control

Functions

- Two universally configurable control loops:
 - Functions for dehumidifying, set point shift and cascade control
 - Multiple auxiliary functions: heat-cool auto changeover, automatic enable, set point compensation
 - Free heating and cooling with economizer function based on enthalpy or temperature
 - Differential, averaging, min and max functions, enthalpy and dew point calculations
 - Transmitter function for sensors and set points
- Universal analog outputs (VDC, mA) and one relay with a normally open and a normally closed contact (SPDT)
- 8 freely assigned alarm conditions, selectable state of outputs on alarm condition
- Password protected programmable user and control parameters
- Measures temperature

Types and Ordering

Product Name	Product No.	Loop	UI	DO	AO	Functions	AO1
SDC2-16-T-200.101U-1	40-300169	2	-	1	1	T = Temperature sensor	Temp.
SDC2-16-T-200.101U-MOD-1	40-300170	2	-	1	1	MOD = Communication with Modbus RTU or ASCII	Temp.
SDC2-16-T-200.101U-BAC-1	40-300160	2	-	1	1	BAC = Communication with BACnet MS/TP	Temp.

UI = Universal inputs, DO = Digital outputs, AO = Analog outputs

AO1 is the analog output of the controller/sensor. The device is pre-programmed ex works as a transmitter. The sensor is assigned to the analog output according to the table.


Accessories

Product Name	Product No.	Description
Built-in Operation Terminal		
OPC2-S	40-500109	Optional built-in operation display for SDC2 devices
External Operation Terminal		
OPT1-xx	40-50xxxx	A large range of external operation terminals may be found on our website www.vectorcontrols.com . All -VC operation terminals work with this controller
OPA2-xx	40-50xxxx	
Memory		
AEC-PM2	40-500130	Plug-In memory module for fast copying of parameter sets

Technical specifications

Important notice and safety advice

This device is for use as an operating controller or sensor. It is not a safety device. Where a device failure could endanger human life and property, it is the responsibility of the client, installer and system designer to add additional safety devices to prevent such a device failure. Ignoring specifications and local regulations may cause equipment damage and endangers life and property. Tampering with the device and misapplication will void warranty.


Power supply	Power requirements	24 VAC $\pm 10\%$, 50/60 Hz, 15..34 VDC SELV to HD 384, Class II, 48VA max
	Power consumption	Max. 5 VA
	Electrical connection	Screw terminal connectors for wire 0.75...1.5 mm ² (AWG 20...16)
Signal inputs	Temperature sensor	Bandgap sensor
	Range	-40...70 °C (-40...158 °F)
	Measuring accuracy	See Figure 1
	Repeatability	± 0.1 °C, ± 0.2 °F
Signal outputs	Analog outputs	AO1 to AO2
	Output signal	DC 0...10 V or 0...20 mA
	Resolution	9.76 mV or 0.019 mA (10 bit)
	Maximum load	Voltage: $\geq 1k\Omega$ Current: $\leq 250\Omega$
	Relay outputs:	AC Voltage 0...48 VAC, full-load current 2A. DC Voltage 0...30 VDC, full-load current 2A
	Insulation strength between relays contacts and system electronics:	1500V AC to EN 60 730-1
	between neighbouring contacts:	800V AC to EN 60 730-1
Connection to remote terminal	Hardware interface	RS485 in accordance with EIA/TIA 485
	Cabling	Twisted pair (STP) cable
Environment	Operation	To IEC 721-3-3
	Climatic conditions	class 3K5
	Temperature	0...50 °C (32...122 °F)
	Humidity	<85 % RH non-condensing
	Transport & storage	To IEC 721-3-2 and IEC 721-3-1
	Climatic conditions	class 3K3 and class 1K3
	Temperature	-25...70 °C (-13...158 °F)
Standards	Humidity	<95 % RH non-condensing
	Mechanical conditions	class 2M2
	 conformity	
		EMC directive 2014/30/EU
	Low voltage directive	
		2014/35/EU
	Product standards: Automatic electrical controls for household and similar use	EN 60 730 -1
	Electromagnetic compatibility for industrial and domestic sector	Emissions: EN 60 730-1 Immunity: EN 60 730-1
	Degree of protection	IP65 to EN 60 529
	Pollution class	II (EN 60 730-1)
	Safety class:	III (IEC 60536)
	Overvoltage category	II (EN 60 730-1)
General	Material	Fire proof ABS plastic (UL94 class V-0)
	Dimensions: (H x W x D)	160 x 98 x 47 mm (6.3 x 3.9 x 1.9 in)
	Weight (including package)	380g (13.4 oz)

Technical specification communication for -MOD and -BAC types

Network	Hardware interface	RS485 in accordance with EIA/TIA 485
	Max nodes per network	128
	Max nodes per segment	64 (Vector devices only)
	Conductors	Shielded Twisted Pair (STP) cable
	Impedance	100 - 130 ohm
	Nominal capacitance	100 pF/m 16 pF/ft. or lower
	Galvanic isolation	The communication circuitry is isolated
	Line termination	A line termination resistance (120 ohm) shall be connected between the terminals (+) and (-) of the furthestmost node of the network
	Network topology	Daisy chain according EIA/TIA 485 specifications
	Recommended maximum length per chain	1200 m (4000 ft.)
Modbus (-MOD)	Communication standard	Modbus (www.modbus.org)
	Default setting	19200 baud rate, RTU 8 data bits, 1 even parity bit, 1 stop bit
	Communication speed	4800, 9600, 19200, 38400
	Protocol: Data bits	RTU - 8 data bits, ASCII - 7 data bits,
	Parity - stop bit	no parity - 2 stops, even or odd parity - 1 stop
BACnet® (-BAC)	Communication standard	BACnet™ MS/TP over RS485 BTL tested and listed B-ASC
	Communication speed	9600, 19200, 38400, 57600, 76800, 115200



Dimensions mm (in)

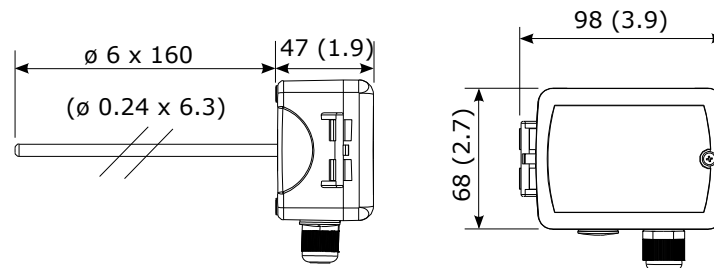

Selection of actuators and sensors

Temperature sensors

Use Vector Controls NTC sensors to achieve maximum accuracy: SDB-Tn10-20 (duct), SRA-Tn10 (room), SDB-Tn10-20 + AMI-S10 as immersion sensor.

Actuators


Choose modulating actuators with an input signal type of 0/2-10 VDC.

3-point actuators with constant running time are recommended.

Binary auxiliary devices (e.g. pumps, fans, on/off valves, humidifiers, etc.)

Do not directly connect devices that exceed specified limits in technical specifications – observe startup current on inductive loads.

Connection diagram

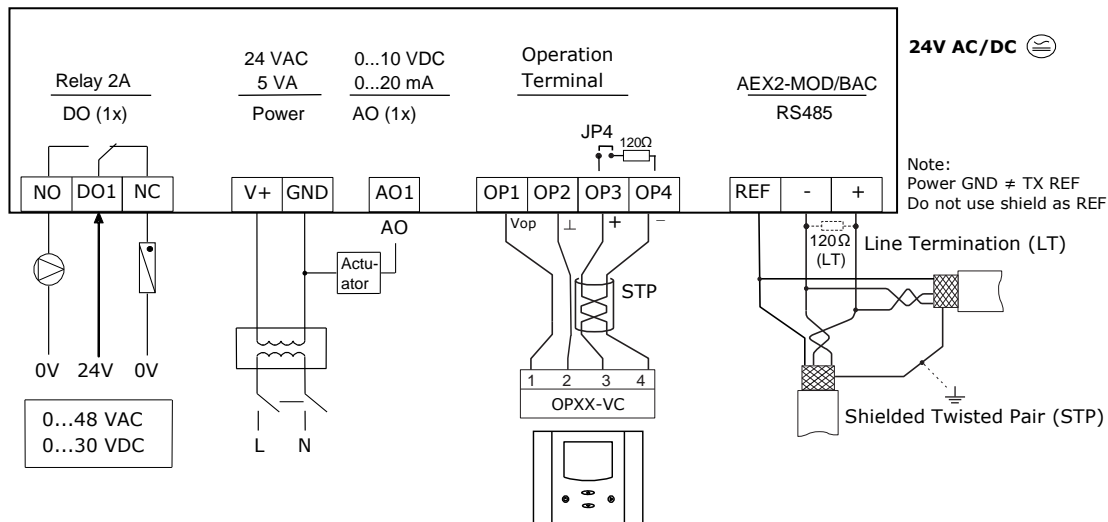

LED-indicators

A status LED is located in the controller housing. During normal operation the LED blinks briefly once every 5 seconds. If there is an alarm or fault condition it will blink every second. See also installation sheet point number D. The function of the system LED is explained in the engineering manual.

The Modbus-slave or BACnet® interface features a green LED and a red LED for indication of traffic on the RS-485 bus. The green LED is lit when an incoming packet is received, and the red LED is lit when an outgoing packet is transmitted to the bus. At power-up, both LED blink twice simultaneously as a sign of the boot process being completed. A constantly lit LED serves as an indication of a fault condition in the reception or sending process.

Installation

See installation sheet no:

- SDC2-T-200 70-000712 (www.vectorcontrols.com)

Wire type

An EIA-485 network shall use shielded, twisted-pair cable for data signalling with characteristic impedance between 100 and 130 ohms. Distributed capacitance between conductors shall be less than 100 pF per meter (30 pF per foot). Distributed capacitance between conductors and shield shall be less than 200 pF per meter (60 pF per foot). Foil or braided shields are acceptable.

Maximum length

The maximum recommended length per segment is 1200 meters (4000 feet) with AWG 18 (0.82 mm² conductor area) cable.

SDC2-T-BAC Protocol Implementation Conformance Statement (PICS)

Vendor Name: Vector Controls

Product Name: SDC2-T Controls series

SDC2-T product description:

The SDC2-T communicating BACnet® controllers are designed as universal controls equipment suitable for a large number of applications. They may be used in zoning and other applications which are monitored by a BACnet® MS/TP network.

Supported BACnet® Interoperability Blocks (BIBB)

The BACnet® interface conforms to the B-ASC device profile (BACnet® Application Specific Controller).

The following BACnet® Interoperability Building Blocks (BIBB) is supported.

BIBB	Type	Name
DS-RP-B	Data sharing	Read property - B
DS-RPM-B	Data sharing	Read property multiple - B
DS-WP-B	Data sharing	Write property - B
DM-DCC-B	Device management	Device communication Control - B
DM-DDB-B	Device management	Dynamic device binding - B
DM-DOB-B	Device management	Dynamic object binding - B
DM-TS-B	Device management	Time synchronisation - B
DM-UTC-B	Device management	UTC Time synchronisation - B
DM-RD-B	Device management	Reinitialize device - B

Supported standard BACnet® application services

- ReadProperty
- ReadPropertyMultiple
- WriteProperty
- DeviceCommunication. Needs a password which is "Vector" (case sensitive and without the quotes).
- I-Am
- I-Have
- TimeSynchronisation
- UTCTimeSynchronisation
- ReinitializeDevice ("cold" or "warm"). Needs a password which is "Vector" (case sensitive and without the quotes).

Supported standard Object types

- Device
- Analog input
- Analog value
- Binary value
- Multi-state Value

Sensors

Temperature sensors on -T- types

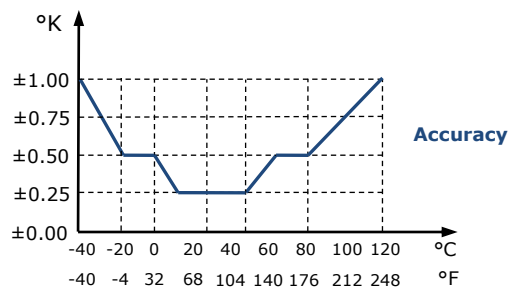


Figure 1: Max T-tolerance by sensor type

X2 Functional Scope

The controller has the following X2 functions and elements:

Group	Modules	QTY	Description
UP			User and display parameters
UI	01U to 05U	5	Sensor inputs for temperature
	06U to 09U	4	Virtual inputs for operation terminals, bus modules or special functions
AL	1AL to 8AL	8	Alarm conditions
LP	1L to 2L	2	Control loops
Ao	1A	1	Analog output for mA, VDC
FAN	1F	1	Fan or lead lag modules, 1 to 3 fan speeds, up to 3 switching lead-lag stages each
do	1d	1	Binary output with a normally open and a normally closed (SPDT) relays contact
FU	1FU	1	Remote Enable: Activation of the controller based on signal and alarm conditions
	2FU	1	Change Operation Mode: Switching occupied and unoccupied with control signals
	3FU	1	Heat/Cool Change: Switching heating and cooling based on a control signal
	4FU	1	Setpoint Compensation: Summer/winter compensation of setpoint
	5FU	1	Economizer (free heating or cooling due to the condition of outside and room air)
Co			Communication (if a communication module is available)
COPY			Copying complete parameter sets between run, default and external memory with up to 4 memory locations (AEC-PM2)

Operation manual and configuration

This controller uses the latest generation X2 operating system. Detailed operating instructions for all devices equipped with this operating system can be downloaded here

<http://www.vectorcontrols.com/products/x2>

Also available are programming instructions for technicians and an application database.

The device can be fully configured using EasySet.

EasySet may be downloaded free of charge from www.vectorcontrols.com.

Empty page.

Smart Sensors and Controls Made Easy!

Quality - Innovation – Partnership

Vector Controls LLC
USA

infous@vectorcontrols.com
www.vectorcontrols.com

