

OPA-D5, OPU-D5 operation terminal for TLR-D5 base units

Features

- Temperature control for 2 and 4-pipe fan coil systems.
- Automatic fan control for three stage fans.
- Control for heating, cooling and fan only operation
- Cost saving option with economy functionality and set point limitation
- Password protected programmable user and control parameters
- External sensor or open contact for remote control, external heat - cool change or auto-changeover on supply temperature with selectable activation limits
- One terminal may control up to 8 base units in master-slave mode

Deluxe version:

- Clock and time schedule functions with 48h power backup
- Blue backlight for LCD
- Infrared remote controller option:
With special features for boost and delayed switching on or off

Ordering

A working controller consists of one operation terminal and at least one base unit.

Item name	Item code	Function	Type	Key-data
TLR-D5-24	40-11 0017	24 VAC	Base unit	Fan coil controller with: 1 TI int or ext 3 DO (Relay) Fan control 2 DO (Relay) Binary control
TLR-D5-230	40-11 0018	230 VAC		
OPA-D5	40-10 0083	Standard	Operation terminal (88x88)	
OPA-D5-D	40-10 0084	Deluxe	Operation terminal (2x4")	
OPU-D5	40-10 0091	Standard	Operation terminal (2x4")	
OPU-D5-D	40-10 0092	Deluxe	Operation terminal (2x4")	
Parameter preset OPA-D5-xx	40-11 00xx	2-Pipe system		Add -Wx at the end of the item name or -x at the end of item code to order pre-configured model
OPA-D5-xx -W01	40-11 00xx -01	Cooling only		

Accessories

Accessories	Item code	Function	Type	Key-data
OPR-1	40-50 0001		2xAAA bat	Infrared remote controller
S-Tn10-2	40-20 0001	Flying lead sensor with 2 m cable		
SD-Tn10-12-2	40-20 0002	Flying lead duct sensor 12 cm immersion depth, 2 m cable		
SD-Tn10-20-2	40-20 0003	Flying lead duct sensor 20 cm immersion depth, 2 m cable		
SDB-Tn10-12	40-20 0051	Duct sensor with housing, 12 cm immersion depth		
SDB-Tn10-20	40-20 0004	Duct sensor with housing, 20 cm immersion depth		
SRA-Tn10	40-20 0005	Room sensor		
SOD-Tn10	40-20 0059	Outdoor sensor		

Selection of valve actuators, fans and sensors

Temperature sensors: Use only our approved NTC sensors to achieve maximum accuracy. .

Binary auxiliary devices: E.g. fans and on/off valves. Do not directly connect devices that exceed 250 VAC, 10(6) A.

Configuration of external input

The external input may be configured as external temperature control input or as binary input. The external temperature input can replace the internal sensor as control input or serve as input for the auto-changeover function. The binary input may be used to toggle comfort and economy modes or comfort and off modes. This may be used together with key card switches for hotels or motion detectors for offices.

Installation terminal

1. Install the mounting plate to the electrical connection box. Make sure that the nipple with the front holding screw is facing to the ground. Make sure the screw heads do not stand out more than 5 mm of the surface of the mounting plate.
2. Connect the wires of the terminals to the communication wires according wiring diagram
3. Slide the two latches located on the top of the front part into the hooks of the mounting plate.
4. Lower the front part until located flat on the wall and the mounting plate is not visible anymore. Make sure the connection cable does not get into the way.
5. Tighten the front holding screw to secure the front part to the mounting plate.

Connection base to terminal

- Max. distance: 200 m (565 ft.)
- Normal twisted pair copper wires maybe used for wiring in an EMC-save environment. In an impaired EMC environment use only shielded cables. The operating voltage must comply with the requirements for safety extra-low voltage (SELV) as per EN 60730.
- 1 terminal may drive up to 8 base units. See wiring for parallel connections. Total wire distance should not exceed 200 m.
- Conductor resistance will influence external temperature reading. 450 Ω will result in an increase of 1 °C (2 °F). Compensate using UP-08 if external temperature is used to control unit.

Technical specification

Power supply	Operating voltage	5 VDC ±10%
	Power consumption	30 mA max
	Electrical connection	Terminal connectors
	Deluxe type only:	
	Power backup for real time clock	Min 48 h if charged for 24 h
Signal inputs	Temperature Inputs	0...50 °C (32...122 °F)
	Range	0.5 °C, 1 °F
	Accuracy	
Communication base - terminal	Communication type	Digital: peer to peer
	Cable type Max distance	Use twisted pair copper wire 0.8...2.5 mm ² (AWG18...AWG13) 200m (650 ft) use shielded wire. Conductor resistance must be compensated if external sensor is used
Environment	Operation	To IEC 721-3-3 class 3K5
	Climatic conditions Temperature Humidity	0 °C...50 °C (32 °F...122 °F) < 95% RH non-condensing
	Transport & Storage	To IEC 721-3-2 and IEC 721-3-1 class 3K3 and class 1K3
Standards	Climatic conditions Temperature Humidity Mechanical conditions	-10 °C...70 °C (14 °F...158 °F) < 95% RH non-condensing class 2M2
	CE conformity EMC directive low voltage directive	2004/108/EC 2006/95/EC
	Product standards Automatic electrical controls for household and similar use Special requirement on temperature dependent controls	EN 60730-1 EN 60730-2-9
General terminal	Electromagnetic compatibility for domestic sector	Emissions: EN 60730-1 Immunity: EN 60730-1
	Safety class	III (IEC 60536)
Safety class	Degree of protection	IP30 to EN 60529
	Material: Cover	ABS plastic (UL94 class V-0)
	Mounting plate	Galvanized steel
	Color	White RAL 9003
	Dimensions (H x W x D) : OPA :	88 x 88 x 24 mm (3.5 x 3.5 x 0.9 in)
	OPU :	112 x 73 x 18 mm (4.4 x 2.9 x 0.8 in)
	Weight including package: OPA-D5, OPU-D5	180 g (6.3 oz)
	OPA-D5-D, OPU-D5-D	190 g (6.7 oz)


Power failure

All the parameters and set points are memorized and don't need to be reentered. The clock will need to be reset.


Error messages

- Err1:** Error temperature sensor. The internal temperature sensor may be damaged or not present.
Err2: External input for heat / cool auto-change-over missing or damaged.
FP: Frost protection is active.

Wiring Diagram



Dimensions

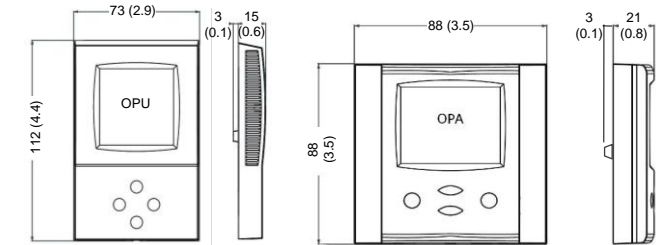

Configuration parameters for firmware version 2.5

This controller can be adapted to wide variety of fan coil applications. The adaptation is done with parameters. The parameters can be changed on the unit without the need of additional equipment.

Identifying the firmware version

The parameters and functionality of controller depend on its firmware revision. It is therefore important to use a matching product version and parameter set. The firmware version is shown on the large LCD digits when pressing UP and DOWN buttons for more than 3 seconds simultaneously.

Changing parameters

The parameters may only be accessed by entering a code. There are two levels of parameters: User operation parameters for access control settings and Expert parameters for control functions and unit setup. The codes for user levels and expert levels are different. Only control experts should be given the control parameter code.

The parameters can be changed as follows:

1. Press UP and DOWN button simultaneously for three seconds. The display shows the software version in the large digits and the software revision in the small digits.
2. Pressing the OPTION button will indicate CODE on the small digits and 000 on the large digits.
3. The code for accessing the user parameters is 009
4. Select this using UP or DOWN buttons.
5. Press OPTION button after selecting the correct code.
6. Once logged in, the parameter is displayed immediately.
7. Select the parameters with the UP/DOWN buttons. Change a parameter by pressing the OPTION button. The MIN and MAX symbols show up and indicate that the parameter may be modified now. Use UP or DOWN buttons to adjust the value.
8. After you are done, press OPTION or POWER in order to return to the parameter selection level.
9. Press the POWER button again so as to leave the menu. The unit will return to normal operation if no button is pressed for more than 5 minutes.

User parameters (access code: 009)

Parameter	Description	Range	Standard
UP 00	Enable change of operation modes.	ON, OFF	ON (Enabled)
UP 01	Enable change of set points	ON, OFF	ON (Enabled)
UP 02	Enable manual control fan speeds	ON, OFF	ON (Enabled)
UP 03	Enable manual change of heating/cooling/fan only mode 0 = manual mode change disabled 1 = fan only enabled 2 = manual heat/cool mode change enabled 3 = manual heat/cool/fan only mode enabled	0, 1, 2, 3	W00: 3 (heat/cool/fan only) W01: 1 (fan only)
UP 04	Enable access to time programs	ON, OFF	ON (Enabled)
UP 05	State after power failure: 0 = OFF, 1 = ON, 2 = Last State	0, 1, 2	2
UP 06	Enable economy (unoccupied) mode. Shift the set point to a lower temperature in winter or higher temperature in summer in order to save energy. May be activated through the POWER button, or with the external input (typically for key card switches in hotel rooms or motion detectors for meeting rooms.)	ON, OFF	ON (Economy)
UP 07	Celsius or Fahrenheit, OFF for Celsius, ON for Fahrenheit	ON, OFF	OFF (Celsius)
UP 08	Calibrate internal temperature sensor -10 ° to +10 ° in 0.1 ° steps. (Sensor is factory calibrated, use this feature for field adjustment only as required.)	-10...10	0
UP 09	Enable frost protection. Activates the output independent of operation mode when the control temperature drops below 5 °C or 41 °F. The controller returns to normal operation when the temperature increases above 10 °C or 50 °F.	ON, OFF	W00 = ON W01 = OFF
UP 10	Select contents of large LCD display in standard mode: 00 = OFF 01 = Set point *1) 02 = Temperature sensor *1) Note: if UP10 = 1, the set point will be shown instead of the measured temperature also in controls display.	03 = Output fan speed 04 = Clock 05 = Alternative sensor	0...5 02 Temperature
UP 11	Select contents of small LCD display in standard mode 00 = OFF 01 = Set point 02 = Temperature sensor	03 = Output fan speed 04 = Clock 05 = Alternative sensor	0...5 Standard: 01 Set point Deluxe: 04 Clock
UP 12	Clock display type: Only available for deluxe version OFF = Show 24hour clock ON = Show 12hour clock (AM, PM)	ON, OFF	OFF (24 h)
UP 13	Reset timer for override mode: Only available for deluxe version 0 = Reset of override mode is not active. 1...255 = delay in minutes to switch off device if ON/Economy mode is activated while the unit is scheduled to be in OFF mode	0...255	60 (Min)

Control parameters (access code: 241)

Warning! Only experts should change these settings!

Set point limit parameters

Parameter	Description	Range	Standard
FC 00	Minimum set point limit in Heating mode	-40...60 °C (160 °F)	16 °C (61 °F)
FC 01	Maximum set point limit in Heating mode	-40...60 °C (160 °F)	24 °C (76 °F)
FC 02	Minimum set point limit in Cooling mode	-40...60 °C (160 °F)	18 °C (65 °F)
FC 03	Maximum set point limit in Cooling mode	-40...60 °C (160 °F)	30 °C (87 °F)

Control loop parameters

FC 04	Economy (unoccupied) mode temperature shift: The comfort (occupied) set point is shifted by the value set with parameter. If heating is active the comfort set point will be decreased, if cooling is active, the set point will be increased. (Enable with UP06.)	0...100 °C (200 °F)	5.0 °C (10 °F)
FC 05	Switching span heating	0...100 °C (200 °F)	0.9 °C (1.8 °F)
FC 06	Switching span cooling	0...100 °C (200 °F)	0.7 °C (1.4 °F)
FC 07	Switching hysteresis is the difference between switching on and switching off. A small hysteresis will increase the number of switching cycles and thus the wear on fan and relays contacts.	0...100 °C (200 °F)	0.5 °C (1 °F)
FC 08	Mold protection: OFF = disabled, ON = enabled In mold protection, the fan keeps running independent of temperature as long as the unit is switched on.	ON, OFF	OFF
FC 09	Delay OFF (minimum running time)	0...255 s	10 s
FC 10	Delay ON (minimum stopping time)	0...255 s	10 s
FC 11	Control option: 0 = Cooling only 1 = Heating only 2 = 2-pipe system 3 = 4-pipe system 4 = cooling with fan support, heating without fan support	0...4	-W00 = 2 -W01 = 0
FC 12	Dead zone span: The dead zone span lies between the heating and the cooling set point. The output is off while the temperature is within the dead zone span. A negative dead zone is not possible.	0...100 °C (200 °F)	1.0 °C (2 °F)
FC 13	Heat/cool changeover delay (if set to FC11 = ON): A demand to switch between heating and cooling must persist for the length of time set with this parameter before the controller switches. Prevents activation of a sequence during a short-term change in temperature in order to protect equipment (with control overshoot for example)	0...255 min	5 min

Output parameters

FC 14	Output setting, binary or 3-point: OFF = Binary (DO4 Heating, DO5 Cooling) ON = 3-point output (DO4 OPEN, DO5 CLOSE)	ON, OFF	OFF
FC 15	Reversing valve in binary mode 0 = no reversing valve (DO4 Heating, DO5 Cooling) 1 = reversing valve while heating (DO4 R. Valve, DO5 comp.) 2 = reversing valve while cooling (DO4 Comp, DO5 R. valve)	0...2	0
FC 16	Running time in 3-point mode	0...255 s	90 s

→ 3-point floating:

For floating point outputs the running time of the actuator used needs to be specified with FC16. Running time is defined as the time required for the actuator to run from fully open to fully closed and vice versa. Actuators with a fixed running time are recommended. Once fully open or fully closed the running time for the actuator is extended for a full run-time cycle. This will allow the actuator position to be synchronized in case it has been moved during off time or an actuator with variable running time was used.

Input parameters

FC 17	External input: 0 = No external input 1 = External temperature sensor 2 = Occupation sensor – comfort / economy 3 = Occupation sensor – comfort / off 4 = Heat / Cool change by open contact. Contact open = heat 5 = Heat / Cool change by open contact. Contact open = cool 6 = Auto-changeover based on supply temperature 7 = Auto-changeover based on outside temperature 8 = Key card with alternative set point 9 = Key card with full reset after inserting card	0...9	0
FC 18	Activation delay (minutes) = the time the binary input needs to be open before economy/off mode is activated.	0...255 min	5 min
FC 19	Auto-changeover limit cooling for supply temperature FC17 = 6 Auto-changeover limit heating for outside temperature FC17 = 7 or economy set point in heating mode if FC17 = 8	-40...60 °C (160 °F)	16 °C (61 °F)
FC 20	Auto-changeover limit heating for supply temperature FC17 = 6 Auto-changeover limit cooling for outside temperature FC17 = 7 or economy set point in cooling mode if FC17 = 8	-40...60 °C (160 °F)	28 °C (82 °F)
FC 21	Comfort set point in heating mode if FC17 = 9	-40...60 °C (160 °F)	21 °C (70 °F)
FC 22	Comfort set point in cooling mode if FC17 = 9	-40...60 °C (160 °F)	24 °C (75 °F)

→ Configuring the function of the external input

FC17 = 0	Input not used	
FC17 = 1	External control input	The external sensor is the control input. The internal sensor will be disabled.
FC17 = 2	Switching economy and comfort modes	Economy (unoccupied) and comfort (occupied) modes are controlled through an external contact by connecting the input through a dry contact to signal common. This function may be used together with key card switches for hotels or motion detectors for offices.
FC17 = 3	Switching energy hold off and comfort modes	Opening the input will force the unit into the off operation mode. The operation mode cannot be overridden by using the terminal. Connecting the input to signal common returns control of the operation mode to the terminal. This function may be used as window contact to prevent loss of energy.
FC17 = 4	Heat - cool changeover by contact	Switch by open contact: Contact open = heating is active, contact closed = cooling is active.
FC17 = 5	Heat - cool changeover by contact	Switch by open contact: Contact open = cooling is active, contact closed = heating is active.
FC17 = 6	Auto heat - cool change-over by supply temperature	Connect a supply media sensor to the input. Cooling will be activated if a temperature below FC19 is measured. Heating is activated if a value above FC20 is measured
FC17 = 7	Auto heat - cool change-over by outdoor temperature	Connect an outdoor temperature sensor to the input. Cooling will be activated if a temperature above FC20 is measured. Heating is activated if a value below FC19 is measured
FC17 = 8	Key card with alternative set point	As with FC17 = 2, the key card function switches economy (unoccupied) and comfort (occupied) modes. Instead of using the set point shift, the set points in unoccupied mode are defined by parameter FC19 in heating mode and FC20 in cooling mode. Fan speed in unoccupied mode is limited to low speed.
FC17 = 9	Key card with full reset	Similar as FC17 = 8 with the difference that set points, fan speed and operation mode are reset each time the key card is inserted. Operation mode is comfort, fan speed is auto and set points are according FC21/FC22 This is helpful for business hotels.