TCI-C series cabinet mounted universal controller



Features

- Universal PID and/or binary control for any analog input/output signal and range
- Multiple auxiliary functions: heat-cool auto changeover, automatic enable, set point compensation
- Differential, averaging, min. and max. functions
- Cascading of control loops (-C22 type)
- Alarm monitoring of low and high limits on all inputs
- Programmable reaction in case of alarm
- Feedback function for inputs and set points
- Functions for dehumidifying, set point shift, cascade control
- Password protected programmable user and control parameters

TCI-C22 also includes

- Power cap protected real-time clock with 48 hr power backup
- 7-day programmable schedules, with options including change of set points and direct position of manual outputs
- Blue backlight


Applications

- Heat exchangers
- Zoning
- Boilers
- VAV
- Air handlers
- Fan, pump control
- Humidifiers
- Dehumidifiers
- Ventilation
- Radiant heating
- Radiant cooling
- Pressurization

General

- TCI-C11: 1 independent control loop, 2 universal inputs (analog/binary/temp), 2 binary outputs, 1 analog output
- TCI-C22: 2 independent control loops, 4 universal inputs, 2 binary outputs, 2 analog output2.
- Flexible application configuration is made with a parameter-setting routine using the standard operation terminal.

Name

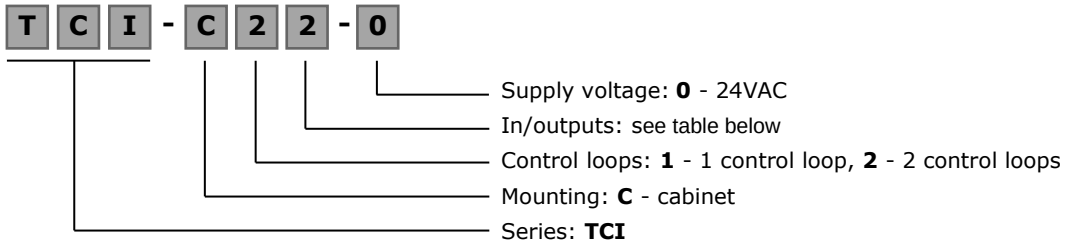

Ordering

Model	Order code	Power	Option	Loop	Input	Temp	Binary output	Analog output
TCI-C11-0	40-11 0060	24 VAC	Standard	1	2	NTC	2 relays	1
TCI-C13-0	40-11 0064	24 VAC	Standard	1	2	NTC	2 TRIAC	1
TCI-C22-0	40-11 0062	24 VAC	Schedules	2	4	NTC	2 relays	2
TCI-C14-0	40-11 0071	24 VAC	Standard	1	2	PT/NI1000	2 relays	1
TCI-C15-0	40-11 0067	24 VAC	Standard	1	2	PT/NI1000	2 TRIAC	1
TCI-C24-0	40-11 0070	24 VAC	Schedules	2	4	PT/NI1000	2 relays	2
TCI-C25-0	40-11 0068	24 VAC	Schedules	2	4	PT/NI1000	2 TRIAC	2

© Vector Controls GmbH, Switzerland


Technical specifications

Caution! This device is intended to be used for comfort applications. Where a device failure endangers human life and/or property, it is the responsibility of the owner, designer and installer to add additional safety devices to prevent or detect a system failure caused by such a device failure. Vector Controls or its affiliates cannot be held liable for any damage caused by such a failure. Failure to follow specifications and local regulations may endanger life, cause equipment damage and void warranty.

Power supply	Power requirements	24 VAC ±10%, 50/60 Hz,24 VDC ±10% SELV to HD 384, Class II transformer, 48 VA max.
	Power consumption	Max. 3 VA
	Electrical connection	Removable terminal connectors, wire 0.34…2.5 mm^2 (AWG 22…13)
	Clock backup	Min. 48 hours
Signal inputs	Universal input Inputs signal Resolution	Input configured for voltage or current 0…10 V or 0…20 mA 9.76 mV or 0.019 mA (10 bit)
	Passive input TCI-C11, TCI-C15, TCI-C22 Type & range: TCI-C14, TCI-C15, TCI-C24, TCI-C25 Type & range:	Input configured to remote temperature (RT) or digital input (DI) NTC (Sxx-Tn10): -40…140 °C (-40…284 °F) PT1000 (Sxx-Tp2): -50…205 °C (-58…401 °F) NI1000 (Sxx-Tk5): -50…180 °C (-58…356 °F)
Signal outputs	Analog outputs Output signal Resolution Maximum load	 DC 0…10 V or 0…20 mA (500 Ω max.) 9.76 mV resp. 0.019 mA (10 bit) 20 mA, 250 Ω max.
	Relay outputs AC voltage DC voltage	TCI-C11, TCI-C22, TCI-C14, TCI-C24 0…250 VAC, 5 (3) A max. each output 0…30 VDC, 5 (3) A max. each output
	TRIAC outputs AC voltage	TCI-C13, TCI-C15, TCI-C25 24…250 VAC, 3A max., 250 VA max. each output
	Insulation strength between relays or TRIAC contacts and system electronics: between neighboring contacts:	 3750 V AC to EN 60 730-1 1250 V AC to EN 60 730-1
Environment	Operation Climatic conditions Temperature Humidity	To IEC 721-3-3 class 3K5 0…50 °C (32…122 °F) <95 % RH non-condensing
	Transport & storage Climatic conditions Temperature Humidity Mechanical conditions	To IEC 721-3-2 and IEC 721-3-1 class 3K3 and class 1K3 -25…70 °C (-13…158 °F) <95 % RH non-condensing class 2M2
Standards	CE conformity EMC directive Low voltage directive	 2004/108/EC 2006/95/EC
	Product standards Automatic electrical controls for household and similar use Special requirement on temperature dependent controls	 EN 60 730 –1 EN 60 730 – 2 – 9
	Electromagnetic compatibility for industrial and domestic sector	Emissions: EN 60 730-1 Immunity: EN 60 730-1
	Degree of protection	IP30 to EN 60 529 if mounted correctly
	Pollution class	II (EN 60 730-1)
	Safety class:	III (IEC 60536) if SELV is connected to DO II (IEC 60536) if line voltage is connected to DO. Local regulations must be observed!
	Overvoltage category	III (EN 60 730-1)
General	Cover, back part	Fire proof ABS plastic (UL94 class V-0)
	Dimensions (H x W x D)	60 x 93 x 115 mm (2.4 x 3.7 x 4.5) inch
	Weight (including package)	TCI-C11, TCI-C14: 280g (9.9oz) TCI-C13, TCI-C15, TCI-C22, TCI-C24: 295 g (10.4 oz) TCI-C25: 305 g (10.8 oz)

© Vector Controls GmbH, Switzerland


Dimensions, mm (inch) and installation

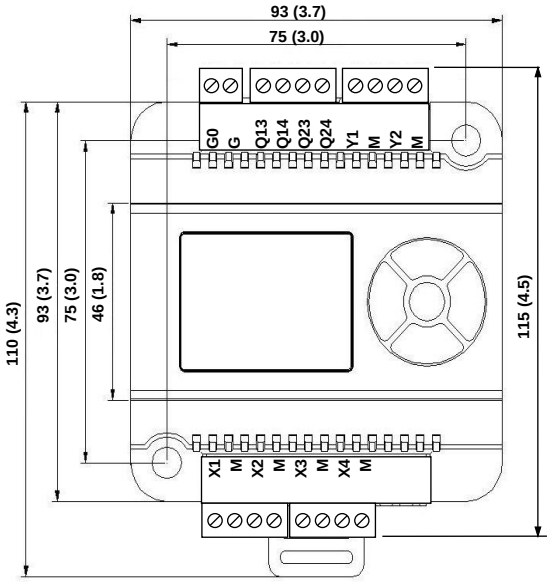

- Mount in standard cabinet to DIN 43880
- Surface mount to top-hat rail to EN 60715
- Surface mount with 2 #4 screws.
- A protective housing must be used if mounted outside an electrical cabinet.
- Ensure adequate air circulation to dissipate heat generated during operation.
- Observe local regulations.
- Do not mount in a wet or condensation prone environment.

See installation sheet no. 70-000537 (www.vectorcontrols.com)

Connection

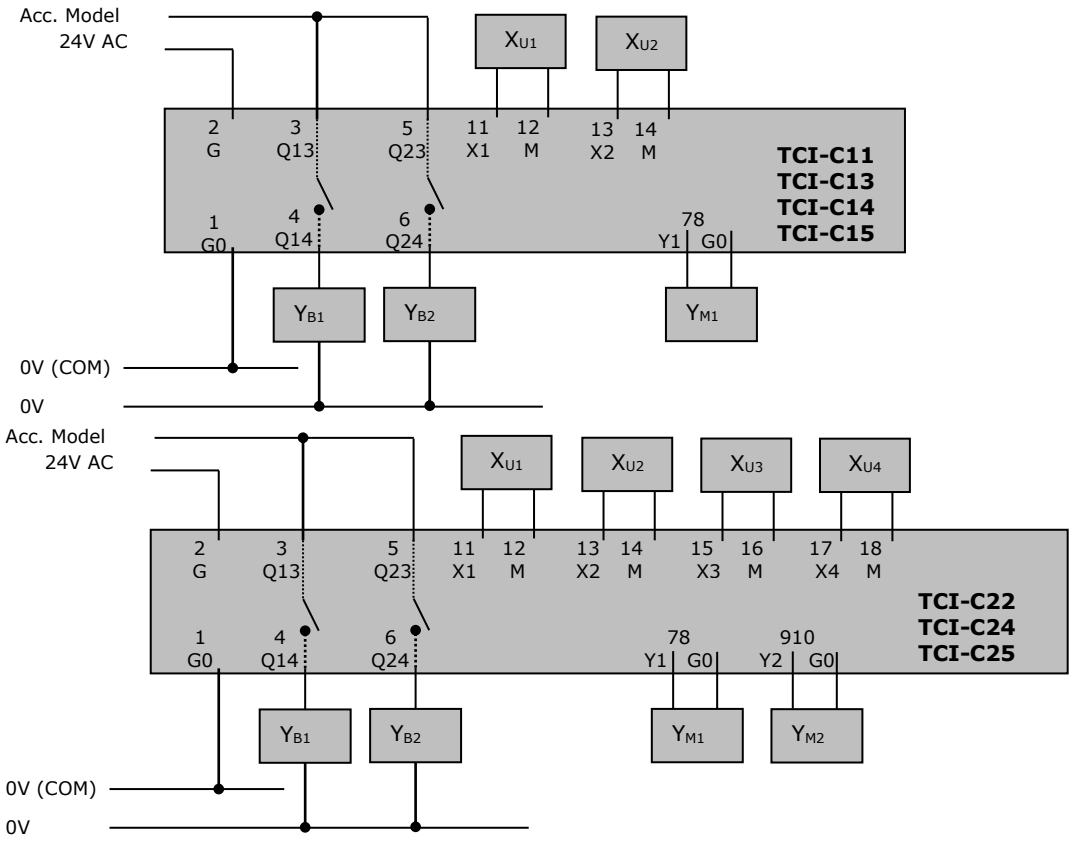

Terminal description

G0	Power supply:	0 V, -24 VDC; common for power supply, analog outputs
G	Power supply:	24 VAC, +24 VDC
M	Signal ground:	Common for universal inputs. Internally connected to G0
Q..	Binary outputs:	Potential free switching contacts, relays or TRIAC depending on type
X..	Universal input:	NTC 10kΩ or PT1000/NI1000 depending on type, 0…10 V or 0…20 mA
Y..	Analog output:	0…10 V or 0…20 mA

Use copper, twisted pair, conductors only. The operating voltage must comply with the requirements for safety extra-low voltage (SELV) as per EN 60 730. Use safety insulating transformers class II with double insulation as per EN 60 742; they must be designed for 100% ON-time. When using several transformers in one system, the connection terminal 1 must be galvanically connected. TCI is designed for operation of AC 24 V safety extra-low voltage and is short-circuit-proof. Supplying voltages above AC 24 V to low voltage connections may damage the controller or other devices. Connection to voltages exceeding 42 V endangers personnel safety.

© Vector Controls GmbH, Switzerland

Selection of sensors and actuators

Temperature sensors: Use Vector Controls NTC or PT1000/NI1000 sensors to achieve maximum accuracy: SDB-Tn10-20 (duct), SRA-Tn10 (room), SDB-Tn10-20 + AMI-S10 as immersion sensor for NTC (used with TCI-C11, TCI-C13 and TCI-C22). SDB-Tp2-20 (duct), SRA-Tp2 (room), SDB-Tp2-20+AMI-S10 (immersion), SOD-Tp2 (outdoor) for PT1000 used with TCI-Cx4 and TCI-Cx5.

Actuators: Choose modulating actuators with an input signal type of 0-10 V DC or 4-20 mA (min. and max. signal limitations may be set with parameters. 3-point actuators with constant running time are recommended.

Binary auxiliary devices (e.g. pumps, fans, on/off valves, humidifiers, etc.): Do not directly connect devices that exceed specified limits in technical specifications – observe startup current on inductive loads.

Mounting and installation

Install the controller in an electrical cabinet, on a top-hat rail or with two screws, as shown in the dimension drawing above.
Mount and connect the controller as shown in the installation sheet supplied with the device, and wire it according to the connection diagram above.

© Vector Controls GmbH, Switzerland