



Wall-mounted Controller and Sensor TRI2-FU

The TRI2 is a programmable controller and sensor with communication capabilities. Each control loop may use 2 PI sequences and 2 binary stages. The TRI2 uses the universal X2 operating system. Serial communication options are realized with Modbus RTU/ASCII and BACnet MS/TP over RS485. There is also a Wi-Fi communication option available which supports Modbus TCP and BACnet IP. An embedded webserver provides a web interface to operate the controller or change the connection settings. Complete parameter sets may be copied by use of an accessory called AEC-PM2 or exchanged with a PC using an RS485-USB converter or Wi-Fi communication, the EasySet program and the configuration adapter called AEC TRI.

Applications

- Ventilation control
- Temperature control
- Zone control
- Air humidifier and dehumidifier

Functions

- Two universally configurable control loops:
 - Functions for dehumidifying, set point shift and cascade control
 - Multiple auxiliary functions: heat-cool auto changeover, automatic enable, set point compensation
 - Free heating and cooling with economizer function based on enthalpy or temperature
 - Differential, averaging, min and max functions, enthalpy and dew point calculations
 - Transmitter function for inputs and set points
- Built in humidity and temperature sensors
- 2 passive inputs (NTC, open contact), 1 analog input (VDC) and 2 analog outputs (VDC)
- 2 relays with each a normally open contact (SPST NO) to switch line voltage
- 8 freely assigned alarm conditions, selectable state of outputs on alarm condition
- Power Cap protected real-time clock with 48hr power backup
- 7-day programmable schedules, with options including change of set points and direct position of manual outputs
- Password protected programmable user and control parameters
- Measures temperature and humidity
- Communication over Modbus, BACnet or Wi-Fi (optional interface required)
- Webserver that supports TRI2 operation through browser or mobile devices (Wi-Fi interface required)

Types and Ordering

Product Name	Product No.	Loop	UI	DO	AO	Functions
TRI2-FU-TH-221.202C	40-100226	2	3	2	2	TH = Temperature- and humidity sensor
TRI2-FU-TH-221.202C-MOD	40-100227	2	3	2	2	MOD = Communication with Modbus RTU or ASCII
TRI2-FU-TH-221.202C-BAC	40-100228	2	3	2	2	BAC = Communication with BACnet MS/TP
TRI2-FU-TH-221.202C-WIM	40-100236	2	3	2	2	WIM = Communication with Modbus TCP over Wi-Fi
TRI2-FU-TH-221.202C-WIB	40-100255	2	3	2	2	WIB = Communication with BACnet IP over Wi-Fi

Accessories

Product Name	Product No.	Description
AEC-PM2	40-500130	Plug-In memory module for fast copying of parameter sets
AEC-TRI	40-500150	Configuration adapter

Safety



DANGER! Safety advice

This device is for use as an operating controller or sensor. It is not a safety device. Where a device failure could endanger human life and property, it is the responsibility of the client, installer and system designer to add additional safety devices to prevent such a device failure. Ignoring specifications and local regulations may cause equipment damage and endangers life and property. Tampering with the device and misapplication will void warranty.

Technical specifications

Power supply	Operating voltage	24 VAC $\pm 10\%$, 50/60 Hz, 15...34 VDC
	Power consumption	Max. 5 VA
	Safety extra-low voltage (SELV)	HD 384, class II
Built in sensors (Type)	Temperature sensor	NTC (Tn10 B25/50: 3935, 10k Ω @25 °C)
	-TH Range	0...50 °C (32...122 °F)
	Measuring accuracy	0.5 °C (1 °F)
	Repeatability	± 0.1 °C, ± 0.2 °F
	Humidity sensor	Capacity sensor element
	Range	0...100% RH
	Measuring accuracy	See Figure 1
	Hysteresis	$\pm 1\%$
	-TH Repeatability	$\pm 0.1\%$
	Stability	< 0.5% / year
	Temperature sensor	Bandgap sensor
	Range	0...50 °C (32...122 °F)
	Measuring accuracy	See Figure 2
	Repeatability	± 0.1 °C (± 0.2 °F)
Signal inputs	Passive input	UI4 to UI5, Passive Temperature NTC or open contact
	Type	NTC (Sxx-Tn10) 10k Ω @25 °C
	Range	-40...100 °C (-40...212 °F)
	Analog input	UI6, in Voltage mode
Signal outputs	Type & range	0 – 10 VDC
	Resolution	9.76 mV (10 Bit)
	Analog output	AO1 to AO2
	Output signal	0...10 VDC
	Resolution	9.76 mV
	Maximum load	≥ 1 k Ω
	Relay outputs: AC Voltage	0...250 VAC, full-load current (1.2) A
	(SPST NO) DC Voltage	0...30 VDC, full-load current 2 A
	Insulation strength between relays contacts and system electronics:	1500V AC to EN 60 730-1
	between neighboring contacts:	1000V AC to EN 60 730-1
Electrical connections	Connector type	Screw terminal connectors for wire 0.34...1.3 mm ² (AWG 22...16)
	Remote terminal	RS485 in accordance with EIA/TIA 485, Shielded twisted pair cable
Environment	Operation	To IEC 721-3-3
	Climatic conditions	Class 3K5
	Temperature	0...50 °C (32...122 °F)
	Humidity	<85 % RH non-condensing
	Transport & storage	To IEC 721-3-2 and IEC 721-3-1
	Climatic conditions	Class 3K3 and Class 1K3
	Temperature	-25...70 °C (-13...158 °F)
	Humidity	<95 % RH non-condensing
Standards	Mechanical conditions	Class 2M2
	Degree of protection	IP30 to EN 60 529
	Pollution class	II (EN 60 730-1)
	Safety class:	II (IEC 60536)
General	Overvoltage category	II (EN 60 730-1)
	Material	Fire proof ABS plastic (UL94 class V-0)
	Dimensions (L x W x H)	Front part: 113 x 72 x 14 mm (4.4 x 2.8 x 0.6 in) Power Case: 50 x 50 x 31 mm (2.0 x 2.0 x 1.2 in)
	Weight (including package)	184g (6.5 oz)

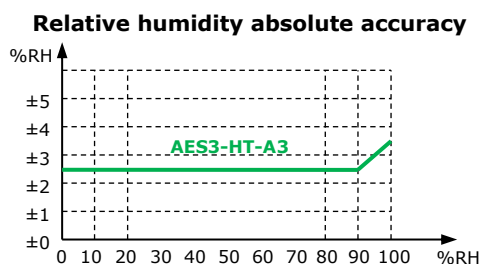


Figure 1: Max RH-tolerance at 25 °C (77 °F) per sensor type

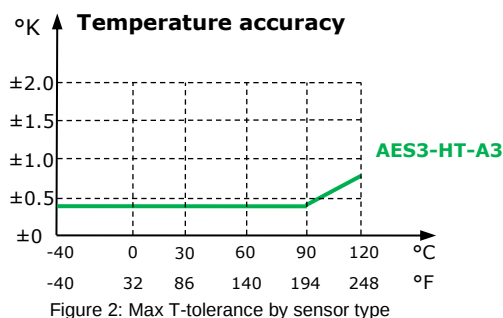


Figure 2: Max T-tolerance by sensor type

Note on accuracy: allow one hour after power up for compensation swing in

Technical specification communication for -MOD and -BAC types

Network	Hardware interface	RS485 in accordance with EIA/TIA 485
	Max nodes per network	128
	Max nodes per segment	64 (Vector devices only)
	Conductors	Shielded Twisted Pair (STP) cable
	Impedance	100 - 130 ohm
	Nominal capacitance	100 pF/m 16 pF/ft. or lower
	Galvanic isolation	The communication circuitry is isolated
	Line termination	A line termination resistance (120 ohm) shall be connected between the terminals (+) and (-) of the furthestmost node of the network
	Network topology	Daisy chain according EIA/TIA 485 specifications
	Recommended maximum length per chain	1200 m (4000 ft.)
Modbus (-MOD)	Communication standard	Modbus (www.modbus.org)
	Default setting	19200 baud rate, RTU 8 data bits, 1 even parity bit, 1 stop bit
	Communication speed	4800, 9600, 19200, 38400
	Protocol: Data bits	RTU - 8 data bits, ASCII - 7 data bits, no parity - 2 stops, even or odd parity - 1 stop
BACnet (-BAC)	Communication standard	BACnet MS/TP over RS485
		BTL tested and listed B-ASC
	Communication speed	9600, 19200, 38400, 57600, 76800, 115200

Technical specification for TCP/IP communication -WIM and -WIB types

Wi-Fi	Standards	Wi-Fi Alliance FCC/CE-RED/IC/TELEC/KCC/SRRC/NCC 802.11 b/g/n (802.11n up to 150 Mbps) A-MPDU and A-MSDU aggregation and 0.4 µs guard interval support
	Frequency range	2.4 GHz ~ 2.5 GHz
	Antenna	Internal
Modbus TCP (-WIM)	Standard	IEC 61158
	Communication protocol	Modbus TCP (www.modbus.org)
	Transport Layer	TCP/IP
	TCP/IP Port	502
BACnet/IP (-WIB)	Communication standard	BACnet/IP
	Transport Layer	BTL tested and listed B-ASC
	UDP Port	47808
		




Product testing and certification



Declaration of
Conformity

Information on the conformity of our products can be found on our website
www.vectorcontrols.com on the corresponding product page under "Downloads".

Dimension, mm (inch)

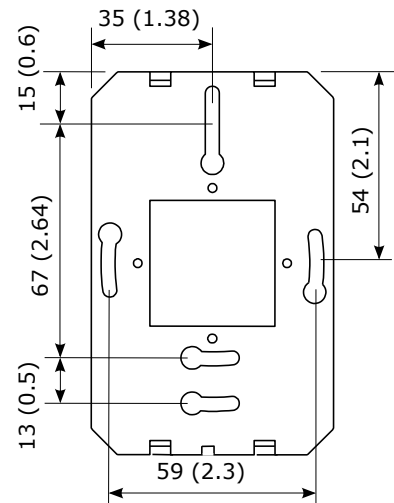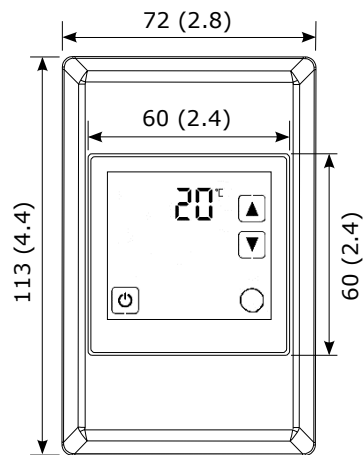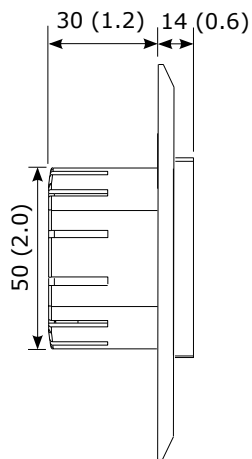

Mounting and Installation

Mounting location

- On a flat, easily accessible wall
- The following mounting locations should be avoided:
 - Protect from direct exposure to sunlight
 - Do not install near heat sources or other heat-generating devices
 - Areas with poor air circulation and niches
 - In the direct influence area of ventilation and fans
 - For the types with wireless transmission (-WIM or -WIB), avoid locations that interfere with the radio signals, e.g. metal boxes or devices that generate electrical interferences.

Mounting instructions



See the TRI2-FU installation sheet, document no. 70-00-0743 (www.vectorcontrols.com).

Selection of sensors and actuators

▲ Temperature sensors

Use Vector Controls NTC sensors to achieve maximum accuracy: SDB-Tn10-20 (duct), SRA-Tn10 (room), SDB-Tn10-20 + AMI-S10 as immersion sensor.

▲ Actuators


Choose modulating actuators with an input signal type of 0/2-10 VDC.

3-point actuators with constant running time are recommended.

Binary auxiliary devices (e.g. pumps, fans, on/off valves, humidifiers, etc.)

Do not directly connect devices that exceed specified limits in technical specifications – observe startup current on inductive loads.

Connection diagram

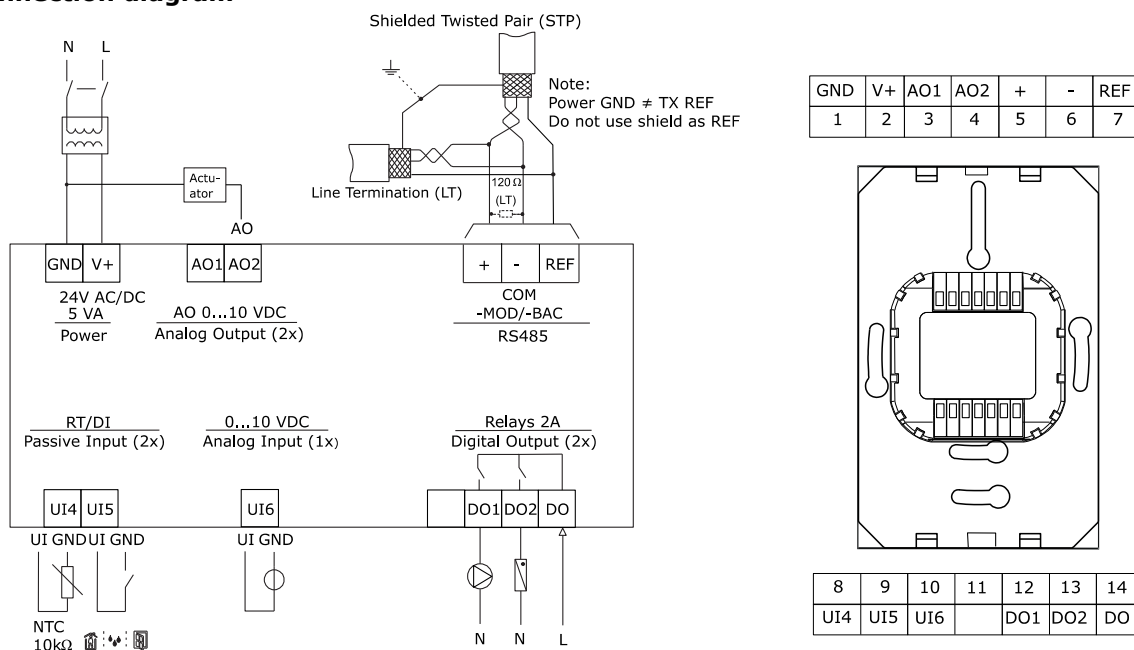

Wire type

An EIA-485 network shall use shielded, twisted-pair cable for data signaling with characteristic impedance between 100 and 130 ohms. Distributed capacitance between conductors shall be less than 100 pF per meter (30 pF per foot). Distributed capacitance between conductors and shield shall be less than 200 pF per meter (60 pF per foot). Foil or braided shields are acceptable.

Maximum length

The maximum recommended length per segment is 1200 meters (4000 feet) with AWG 18 (0.82 mm² conductor area) cable.

Status-LED

The TRI2 has a status-LED which becomes visible by removing the front part. The location of the LED is described in the installation sheet. The function of the LED is explained in the X2 operation manual.

Operation and Configuration

▲ Documentation

This controller uses the latest generation X2 operating system. Detailed operation instructions for all devices equipped with this operating system can be found on our website.

Also available are programming instructions for technicians and an application database.

▲ Configuration



The device can be fully configured and commissioned using the EasySet program.

EasySet may be downloaded free of charge from our website www.vectorcontrols.com.

Documentation overview

Document Type	Document No.	Description
TRI2-FU Data Sheet	70-00-0750	Product data sheet (this document)
TRI2-FU Install Sheet	70-00-0743	Mounting and installation manual
X2 Operations Manual touch display	70-00-0951	Operations instructions of X2 system with touch display
X2 Web Interface operation manual	70-00-0952	Operations instructions of X2 Web interface
X2 Engineering Manual	70-00-0737	Guidelines for configuring the X2 system
X2 Modbus Communication Module (-MOD type)	70-00-0290	Setup and configuration manual Modbus (no Modbus TCP)
X2 Modbus Communication Module (-WEM type)	70-00-0925	Setup and configuration manual Modbus TCP
X2 BACnet Communication Module (-BAC type)	70-00-0218	Setup and configuration manual BACnet (no BACnet/IP)
X2 BACnet/IP Communication Module (-WEB type)	70-00-0899	Setup and configuration manual BACnet/IP
X2 Wi-Fi / Ethernet Communication Manual (-WEM, -WEB type)	70-00-0900	Setup and configuration manual TCP/IP

Note: The above list is not complete. The documents on the website are relevant.

BACnet Protocol Implementation Conformance Statement (PICS)

BACnet MS/TP network

 The following is only valid for products with the **-BAC** type option.

Vendor Name: Vector Controls
Product Name: TRI2 Controls series
TRI2 product description: The TRI2 communicating BACnet controllers are designed as universal controls equipment suitable for a large number of applications. They may be used in zoning and other applications which are monitored by a BACnet MS/TP network.

▲ Supported BACnet Interoperability Blocks (BIBB)

The BACnet interface conforms to the B-ASC device profile (BACnet Application Specific Controller).
The following BACnet Interoperability Building Blocks (BIBB) is supported.

BIBB	Type	Name
DS-RP-B	Data sharing	Read property - B
DS-RPM-B	Data sharing	Read property multiple - B
DS-WP-B	Data sharing	Write property - B
DM-DCC-B	Device management	Device communication Control - B
DM-DDB-B	Device management	Dynamic device binding - B
DM-DOB-B	Device management	Dynamic object binding - B
DM-TS-B	Device management	Time synchronisation - B
DM-UTC-B	Device management	UTC Time synchronisation - B
DM-RD-B	Device management	Reinitialize device - B

▲ Supported standard BACnet application services

- ReadProperty
- ReadPropertyMultiple
- WriteProperty
- DeviceCommunication (password protected)
- I-Am
- I-Have
- TimeSynchronisation
- UTCTimeSynchronisation
- ReinitializeDevice ("cold" or "warm") (password protected)

▲ Supported standard Object types

- Device
- Analog input
- Analog value
- Binary value
- Multi-state Value

BACnet/IP communication

 The following is only valid for products with the **-WIB** type option.

Vendor Name: Vector Controls
Product Name: TRI2 Controls series
TRI2 product description: The X2 communicating BACnet/IP controllers are designed as universal controls equipment suitable for a large number of applications. They may be used in zoning and other applications which are monitored by a BACnet/IP network.

▲ Supported BACnet Interoperability Blocks (BIBB)

The BACnet interface conforms to the B-ASC device profile (BACnet Application Specific Controller).
The following BACnet Interoperability Building Blocks (BIBB) is supported.

BIBB	Type	Name
DS-RP-B	Data sharing	Read property - B
DS-RPM-B	Data sharing	Read property multiple - B
DS-WP-B	Data sharing	Write property - B
DS-COV-B	Data sharing	Change of value - B
DM-DCC-B	Device management	Device communication Control - B
DM-DDB-B	Device management	Dynamic device binding - B
DM-DOB-B	Device management	Dynamic object binding - B
DM-TS-B	Device management	Time synchronisation - B

BIBB	Type	Name
DM-UTC-B	Device management	UTC Time synchronisation - B
DM-RD-B	Device management	Reinitialize device - B

▲ **Supported standard BACnet application services**

- ReadProperty
- ReadPropertyMultiple
- WriteProperty
- ChangeOfValue
- DeviceCommunication (password protected)
- I-Am
- I-Have
- TimeSynchronisation
- UTCTimeSynchronisation
- ReinitializeDevice ("cold" or "warm") (password protected)

▲ **Supported standard Object types**

- Device
- Analog input
- Analog value
- Binary value
- Multi-state Value
- Network Port

X2 Functional Scope

The controller supports the following X2 functions and elements:

Group	Modules	QTY	Description
UP	-	-	User and display parameters
UI	01U to 03U	3	Sensor inputs for temperature and humidity
	04U to 06U	3	Universal inputs for RT/DI, mA, VDC
	07U to 10U	4	Virtual inputs for operation terminals, bus modules or special functions
AL	1AL to 8AL	8	Alarm conditions
LP	1L to 2L	2	Control loops
AO	1A to 2A	2	Analog outputs for mA, VDC
FAN	1F	1	Fan or lead lag modules, 1 to 3 fan speeds, up to 3 switching lead-lag stages each
DO	1d to 2d	2	Binary outputs with a normally open (NO) relays contact
FU	1FU	1	Remote Enable: Activation of the controller based on signal and alarm conditions
	2FU	1	Change Operation Mode: Switching occupied and unoccupied with control signals
	3FU	1	Heat/Cool Change: Switching heating and cooling based on a control signal
	4FU	1	Setpoint Compensation: Summer/winter compensation of setpoint
	5FU	1	Economizer (free heating or cooling due to the condition of outside and room air)
CO	-	-	Communication (if a communication module is available)
COPY	-	-	Copying complete parameter sets between run, default and external memory with up to 4 memory locations (AEC-PM2)
RTC	-	1	Real time clock module with 48-hour power back up (keeps clock running during power failure)
PRO	Pr01 to Pr12	12	Time schedule programs for 7 days or annual switching events



More detailed information on the X2 functions can be found in the "X2 Engineering Manual" on our website www.vectorcontrols.com.

Empty page.

Smart Sensors and Controls Made Easy!

Quality - Innovation – Partnership

Vector Controls GmbH
Switzerland

info@vectorcontrols.com
www.vectorcontrols.com

