

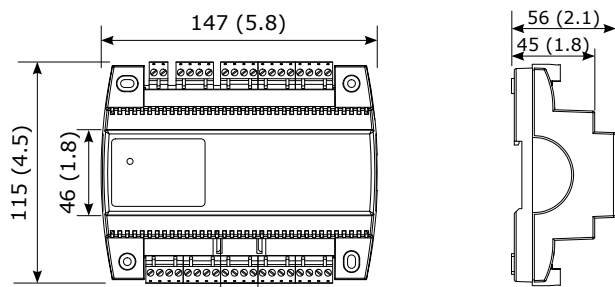


A mm (inch)

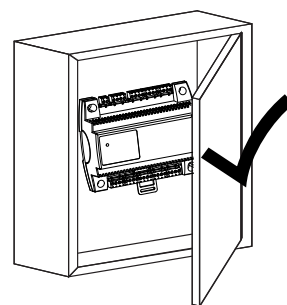


B


i Cabinet mounting




i TCX2-40863

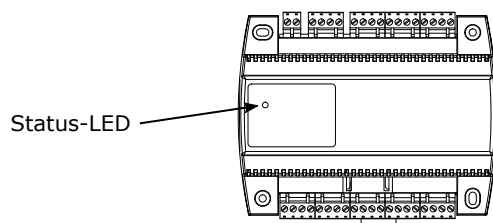


i -OP

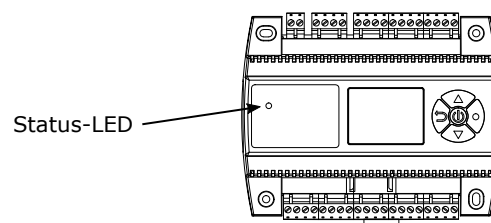

C

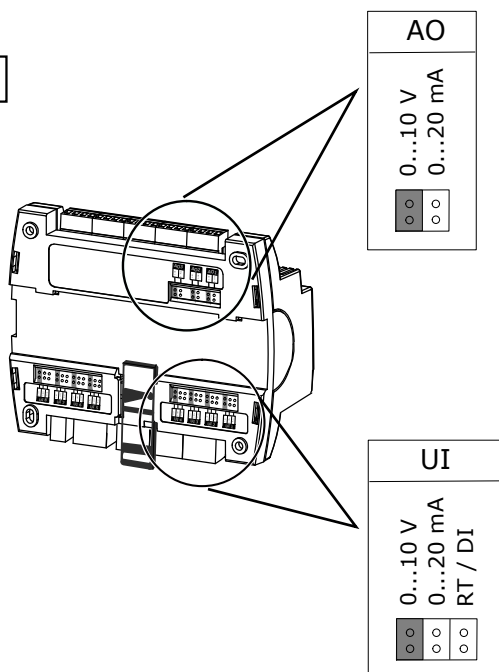


D

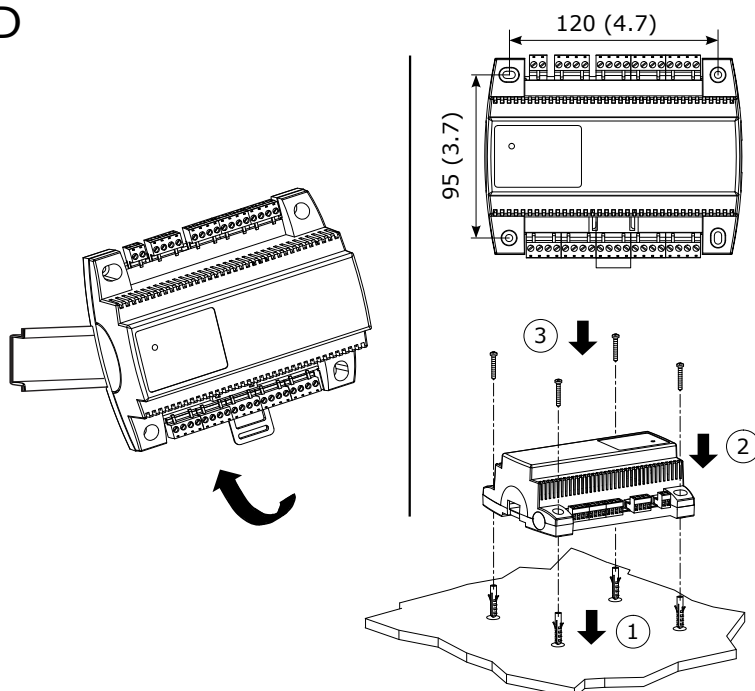

E 24V AC/DC


! G0 = M = GND

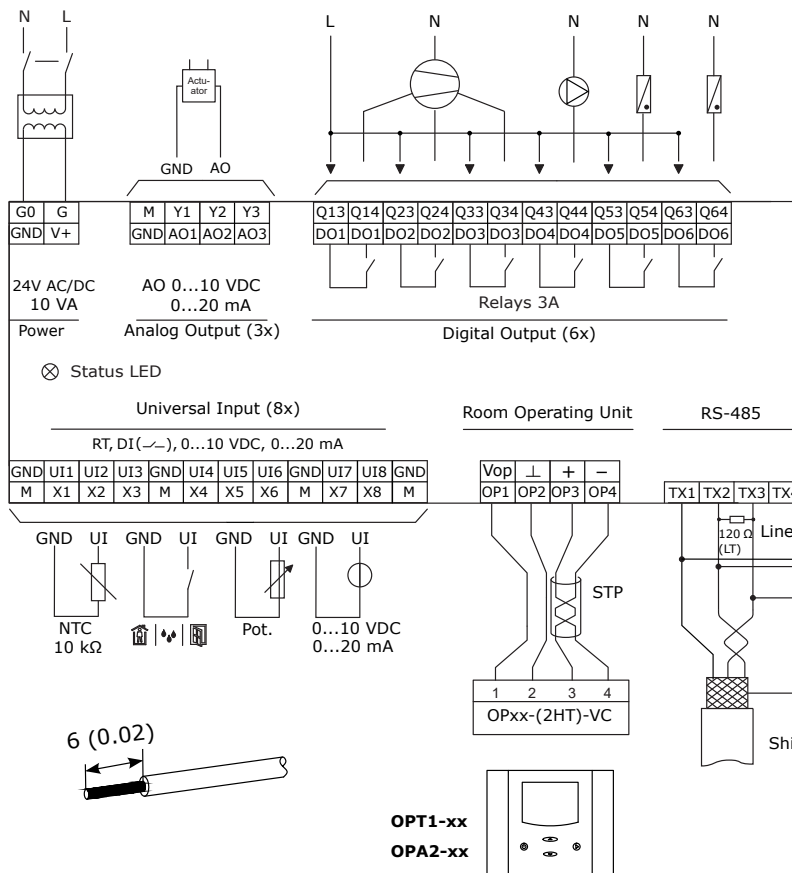


RS-485	TX1	TX2	TX3	TX4
-BAC BACnet MS/TP	REF	—	+	
-MOD MODBUS	REF	— (D0)	+	+

Note: Power GND ≠ TX REF
Do not use shield as REF

i AEC-PM1

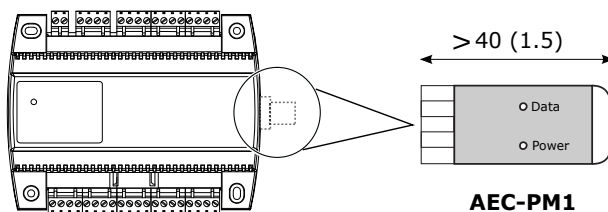

i Easyset

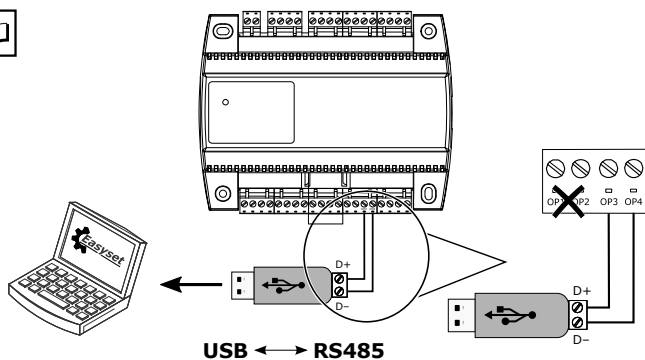

i

Master-Slave (max. 8x TCX2, 1x OPxx-VC)

